

SIEMENS



RDD310

RDE410

Semi flush-mounted room thermostats with LCD

RDD310
RDE410

For heating systems

RDD310 and RDE410 features:

- Operating voltage AC 230 V
- 2-position control with On / Off control output
- Input for an external temperature sensor (QAH11.1 / QAA32)
- Temperature limitation function for heating, controlled by external temperature sensor (optional)
- Operating modes: Comfort, Economy and Protection
- Manual changeover of current operating mode
- Maximum and minimum setpoint limitation
- Backlit LCD
- Mounting on recessed rectangular conduit box, fixing center at 60.3mm

Additional RDE410 features:

- Auto Timer mode with 8 programmable timers (RDE410 only)

Use

The RDD310 / RDE410 controls room temperature in heating systems.

Typical applications:

- Apartments
- Commercial spaces
- Schools


Controls the following equipment:

- Thermal valves or zone valves
- Gas or oil burners
- Fans
- Pumps

Functions

- Maintain room temperature via built-in temperature sensor or external room temperature sensor. The thermostat automatically detects a connected external room temperature sensor .
- Select operating mode via the operating mode button on the thermostat.
- Display current room temperature or setpoint.
- Minimum and maximum setpoint limitation.
- Keypad lock (automatic or manual).
- Temperature limitation for floor heating with an external temperature sensor (optional).
- 7-day time switch: 8 programmable timers to change over between Comfort and Economy mode (RDE410 only).
- Backlit LCD

Function diagram

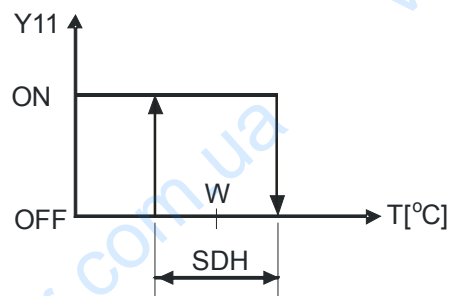

T: Room temperature
SDH: Switching differential heating
W: Room temperature setpoint
Y11: Output signal for heating

Temperature control

The thermostat acquires the room temperature via built-in sensor, external room temperature sensor (QAA32), or external cable temperature sensor (QAH11.1). It maintains the setpoint by sending actuator control commands to the heating equipment. The switching differential is 1 K.


External temperature sensor

The thermostat automatically detects when an external temperature sensor (QAH11.1 or QAA32) is connected.

Floor heating limitation function

The floor heating limitation function is part of the floor heating application. The external floor temperature sensor connected to input B1 acquires the floor temperature. If the floor temperature exceeds the parameterized limit (parameter P51), the heating valve is fully closed until the floor temperature returns to 2 K below the parameterized limit. The factory setting for this function is OFF (disabled).


Operating modes

Select the thermostat's operating mode via operating mode button . A corresponding setpoint is used to maintain the room temperature at the desired level depending on the active operating mode. The following operating modes are available:

Comfort mode

In Comfort mode, the thermostat maintains the setpoint which can be adjusted via the +/- buttons.





Economy mode

Economy mode helps save energy. Select it by pressing the operating mode button  if parameter P02 is set accordingly.

Protection mode

In Frost-Protection mode, the system is protected against frost (factory setting 8 °C).

Auto Timer mode (only with RDE410..)

In Auto Timer mode , the thermostat automatically changes from Comfort to Economy mode as per the 8 preprogrammed timers. The display shows the Auto Timer mode symbol  along with the symbol for the current operating mode (Comfort  or Economy ).







User interface

Display

The digital display displays the acquired room temperature or the setpoint for the current operating mode, selectable via parameter P06. Factory setting displays the current room temperature.

Use parameter P04 to select room temperatures and setpoints for display in °C or °F.



1. Operating mode
 -  Protection mode
 -  Auto Timer mode*
 -  Comfort mode
 -  Economy mode
2. Display room temperature, setpoints and control parameters.
 -  Symbol used to display the current room temperature
3.  Heating mode
4. Current time of day (RDE410 only)
5. Weekday 1..7
 - 1 = Monday / 7 = Sunday (RDE410 only)
6. Keypad lock active








Ordering

Indicate both product number and description when ordering:

E.g. **RDD310 room thermostat**

Order sensors and valve actuators separately.

Equipment combinations

	Description	Product no.	Data sheet ^{*)}
Sensors	Cable temperature sensor 	QAH11.1	1840
	Room temperature sensor 	QAA32	1747
On/off actuators	Electromotoric actuator with on/off valve (only available in AP, UAE, SA and IN) 	MVI... / MXI...	4867
	Electromotoric on/off actuator 	SFA21...	4863
	Thermal actuator (for radiator valves) 	STA21...	4893
	Thermal actuator (for small valves 2.5 mm) 	STP21...	4878
	Zone valve actuators (only available in AP, UAE, SA and IN) 	SUA...	4830

*) The documents can be downloaded from <http://siemens.com/bt/download>.

Accessories

Description	Product no.	Data sheet
Changeover mounting kit (50 pcs/package)	ARG86.3	1840
Adapter plate 82 mm x 82 mm x 10 mm for conduit	ARG70.3	-
Conduit box 75mm x 75mm x 51mm	ARG71	-


Mechanical design

The thermostat consists of two parts:

- Front panel accommodating the electronics, operating elements and built-in room temperature sensor.
- Mounting base with power electronics.


The rear of the mounting base contains the screw terminals. The base fits on a conduit box with 60.3 mm fixing centers. Slide the front panel in the mounting base and snap on.

RDD310

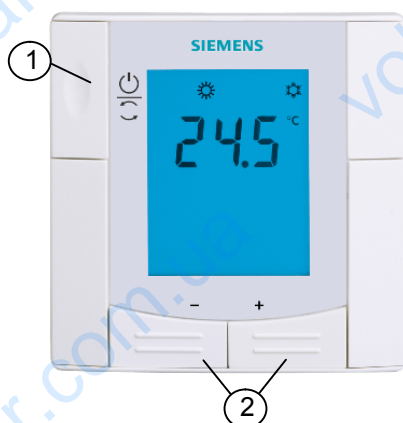

1. Operating mode selector / Protection
2. Adjust setpoint and control parameters

RDE410

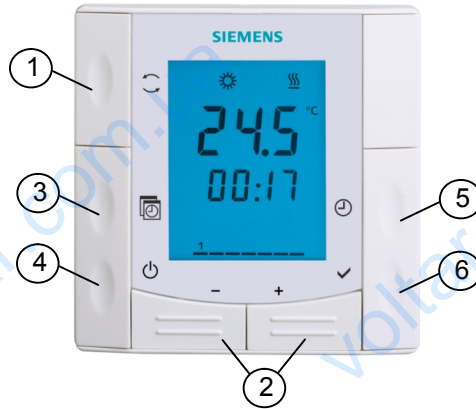

1. Operating mode selector
2. Adjust setpoints, control parameters and time of day
3. Auto Timer program
4. Protection
5. Time of day and weekday
6. Confirm

Setpoints

Comfort mode

The setpoint in Comfort mode is adjusted with the +/- buttons.

Setpoint limitation

The setpoint setting range can be limited to minimum (parameter P09) and maximum (parameter P10) values (if the minimum setting is the same or higher than the maximum setting, the setting range is 5 °C...P10).

Temporary setpoint

If "Temporary setpoint" is enabled via parameter P69, the setpoint adjusted via the +/- buttons is set back to the Comfort basic setpoint when the operating mode changes. Factory setting for the Comfort basic setpoint is 20 °C and can be changed via parameter P08.

Economy mode

Use control parameters P11 to adjust the Economy mode setpoint. Factory setting is 16 °C.

Protection mode


Use control parameters P65 to adjust the Protection mode setpoint. Factory setting is 8 °C.

Caution

If a setpoint is set to OFF, the thermostat does not maintain the setpoint in the corresponding mode, resulting in a risk of frost, i.e. no protective heating or cooling function.

Mounting notes

Mount the room thermostat on a recessed rectangular conduit box with 60.3 mm fixing centers. Do not mount on a wall in niches or bookshelves, behind curtains, above or near heat sources, or exposed to direct solar radiation. Mount about 1.5 m above the floor.

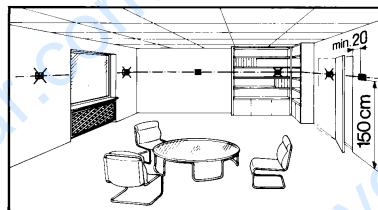

Wiring

See the mounting instructions enclosed with the thermostat.



- Comply with local regulations to wire, protect and earth the thermostat.
- Properly size the cables to the thermostat and actuators for AC 230 V mains voltage.
- Use only actuators rated for AC 230 V on RDD310... / RDE410...

Warning!

No internal line protection for supply lines to external consumers (Y11)

Risk of fire and injury due to short-circuits!



- Adapt the line diameters as per local regulations to the rated value of the installed overcurrent protection device.
- The AC 230 V mains supply line must have an external circuit breaker with a rated current of no more than 10 A.
- Isolate the cables of SELV inputs B1-M.

Installation notes

Sensor calibration

- Recalibrate the temperature sensor if the room temperature displayed on the thermostat does not match the room temperature measured. To do this, change parameter P05.

Setpoint and range limitation

- We recommend reviewing setpoints and setpoint ranges (parameters P08...P11) and change as needed to achieve maximum comfort and save energy.

Reset parameters

- The factory setting for the control parameters can be reloaded via parameter P71, by changing the value to ON, and confirming by pressing buttons + and – simultaneously. The display shows “888” during reload.




Floor temperature limitation

- The floor temperature sensor, connected to inputs B1-M, acquires the floor temperature.
- The factory parameter setting (P51) for this function is 40°C. Both temperature value acquired by built-in sensor and floor heating temperature limitation value are being monitored by thermostat. For ambient temperature acquired by built-in temperature sensor, the output demand is controlled by thermostat display setpoint. For floor heating limitation sensor, if the temperature exceeds the parameterized limit (parameter P51), the heating valve is fully closed until the floor temperature again drops to 2 K below the parameterized limit. Temperature value being shown on thermostat display is room temperature value.
- If Floor heating temperature limit parameter (P51) is set as “OFF”, temperature acquired by floor temperature sensor temperature value will be shown on thermostat display instead of room temperature value. If the temperature exceeds the parameterized limit (parameter P51), the heating valve is fully closed until the floor temperature again drops to 2 K below the parameterized limit.

Commissioning notes

After connecting to power, the thermostat carries out a reset during which all LCD segments flash indicating that the reset was correct. After the reset, which takes about 3 seconds, the thermostat is ready for commissioning by qualified HVAC staff. The control parameters of the thermostat can be set to ensure optimum performance of the entire system (see below).

Control parameters for RDD310 and RDE410:

#	Parameter	Factory setting	Setting range
Service level			
P02	Mode selection by operating mode button 	1 = Protection – Comfort mode	1 = Protection – Comfort mode 2 = Protection – Comfort – Economy mode
P04	Selection of °C or °F	°C	°C or °F
P05	Temperature sensor calibration	0.0 °C	- 3 ... 3 °C
P06	Standard temperature display	0 = room temperature	0 = room temperature 1 = setpoint
P08	Comfort basic setpoint	20 °C	5 ... 40 °C
P09	Min. setpoint limitation in Comfort mode ($W_{minComf}$)	5 °C	5 ... 40 °C
P10	Max. setpoint limitation in Comfort mode ($W_{maxComf}$)	35 °C	5 ... 40 °C
P11	Heating setpoint in Economy mode	16 °C	OFF, 5...18 °C
P14	Button lock (press operating mode button  for 7 seconds to lock or unlock the buttons)	0 = disabled	0 = disabled 1 = auto lock 2 = manual lock
Expert level			
P30	Switching differential in heating mode	1 K	0.5 ... 6 K
P51	Floor heating temperature limit	40 °C	OFF, 10...55 °C
P65	Setpoint of heating in Protection mode  ($W_{heatStb}$)	8 °C	OFF, 5 °C...18 °C
P69	Temporary setpoint in Comfort mode	ON	OFF = Disabled ON = Enabled
P71	Parameter reset Set value to ON and confirm by pressing + and – buttons	---	OFF = Idle ON = Reset
Diagnostics and test			
d02	Status X1	Diagnostics	0...49 °C = measured temp. value

Parameter adjustment for service and expert level:

The parameters are divided into “Service level” and “Expert level”. The parameter setting mode can be entered as follows:


Set the thermostat to OFF / Protection .

Service level only
(P02...P14)

- Press buttons + and – simultaneously for 3 seconds. Release them and, within 2 seconds, press button + for another 7 seconds. Parameters P02...P14 can be adjusted (service level).

Expert level plus
service level (all
parameters,
P02...P71)

- Press buttons + and – simultaneously for 3 seconds. Release them and, within 2 seconds, press button – for another 3 seconds. Parameters P02...P71 can be adjusted (expert level).



Parameters can be readjusted as follows in the parameter setting mode:

1. Select the required parameter by repeatedly pressing button + or –.
2. When pressing buttons + and – simultaneously, the current value of the selected parameter starts to flash; change by repeatedly pressing button + or –.
3. When you again press buttons + and – simultaneously, the next parameter is displayed.
4. Repeat steps 1 to 3 to display and change additional parameters.
5. (For RDD310) 10 seconds after the last display or setting, all changes are stored and the thermostat will leave parameter enter mode.
(For RDE410) Press + or – until “End” is displayed, and then press + and – simultaneously to save the change and exit parameter entry mode.

Maintenance notes

The thermostats are maintenance-free.

Disposal notes



The device is considered an electronic device for disposal in terms of the European Directive 2012/19/EU and may not be disposed of as domestic garbage.

- Dispose of the device through channels provided for this purpose.
- Comply with all local and currently applicable laws and regulations.

Technical data

 Power supply

Operating voltage	AC 230 V +10/-15%
Frequency	50/60 Hz
Power consumption	Max. 8 VA



No internal fuse

External preliminary protection with max. C 10 A circuit breaker in the supply line required under all circumstances.




Outputs

Control output Y11-N1 (N.O.)	AC 230 V
Rating	Max. 5(2) A

Inputs

Temperature sensor input (B1-M):	
Type	QAH11.1 (NTC) / QAA32

Operational data

Switching differential, adjustable	
Heating mode	(P30) 1K (0.5...6 K)
Setpoint setting and range	
 Comfort mode	(P08) 20 °C (5...40 °C)
 Economy mode	(P11) 16 °C (OFF, 5...40 °C)
 Protection	(P65) 8 °C (OFF, 5...40 °C)
Floor temperature limitation setting range	OFF and 20...45 °C
Factory setting	OFF (limitation function not active)

Built-in room temperature sensor

Measuring range	0...49 °C
Accuracy at 25 °C	< ± 0.5 K
Temperature calibration range	± 3.0 K

Settings and display resolution

Setpoints	0.5 °C
Current temperature value displayed	0.5 °C

Environmental conditions

Operation	As per IEC 60721-3-3
Climatic conditions	Class 3K5
Temperature	0...+50 °C
Humidity	<95% r.h.
Transport	As per IEC 60721-3-2
Climatic conditions	Class 2K3
Temperature	-25...+60 °C
Humidity	<95% r.h.
Mechanical conditions	Class 2M2
Storage	As per IEC 60721-3-1
Climatic conditions	Class 1K3
Temperature	-25...+60 °C
Humidity	<95% r.h.

Standards

EU Conformity (CE)	CE1T3076xx_2 ^{*)}
RCM Conformity	CE1T3076en_C1 ^{*)}
Protective class	II as per EN 60730-1
Pollution class	Normal

Environmental compatibility

Degree of protection of housing	IP30 as per EN 60529
The product environmental declarations CE1E3076_1, CE1E3076_2 ^{*)} contain data on environmentally compatible product design and assessments (RoHS compliance, materials composition, packaging, environmental benefit, disposal).	

General

Connection terminals


Solid wires or prepared
stranded wires
2x0.4-1.5 mm² or 1x2.5 mm²

Weight 0.220 kg

Housing front color RAL 9003 white


*) The documents can be downloaded from <http://siemens.com/bt/download>.

Connection terminals

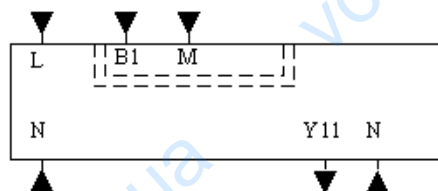


L, N Operating voltage AC 230 V
Y11 Control output "Valve"
AC 230 V (N.O., for normally
closed valves) or output for
electric heater
B1 Input for external temperature
sensor (room temperature
sensor, floor temperature
sensor, etc.)
M Measuring neutral for sensor

Connection diagrams

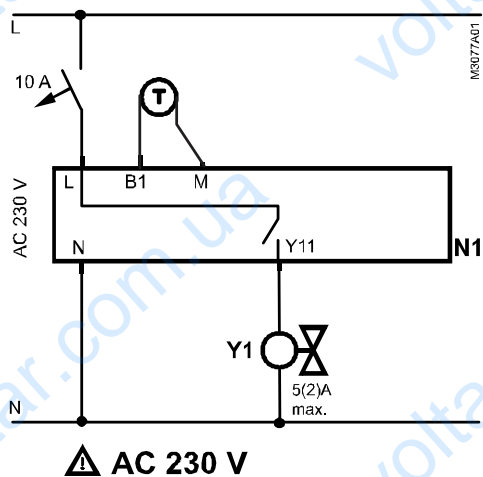


N1 Room thermostat RDD310... /
RDE410...
Y1 Zone valve
B1 Temperature sensor


Application examples

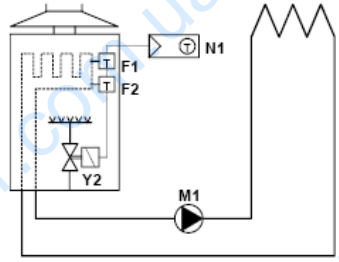

Room temperature controller with direct control of a gas-fired wall-hung boiler

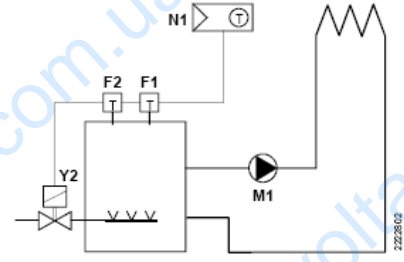

Room temperature controller with direct control of a gas-fired floor-standing boiler

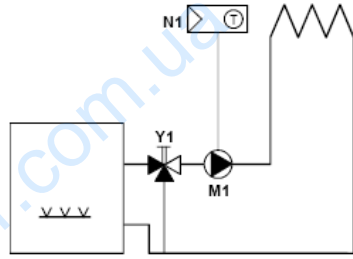

Room temperature controller with direct control of a heating circuit pump (precontrol by manual mixing valve)

F1 Thermal reset limit thermostat
 F2 Safety limit thermostat
 M1 Circulating pump

N1 RDD310/RDE410 room thermostat
 Y1 3-port valve with manual adjustment
 Y2 Magnetic valve

Dimensions

